


GROUP TYPE	KW	Q = ELECTRIC PUMPS TOTAL CAPACITY																				
		l/min 0	40	80	120	160	200	240	280	320	360	400	440	480	520	560	600	640	680	720	760	800
		mc/h 0	2,4	4,8	7,2	9,6	12,0	14,4	16,8	19,2	21,6	24,0	26,4	28,8	31,2	33,6	36,0	38,4	40,8	43,2	45,6	48,0
H = TOTAL PREVALENCE IN METRES OF COLUMNS OF WATER (M.C.A.)																						
FCD40-VLR2B/30	4x0,37	29,5	29,0	27,0	25,0	21,0	17,0	11,0														
FCD40-VLR2B/40	4x0,55	38,0	37,0	35,0	32,0	29,0	23,0	17,0														
FCD40-VLR2B/50	4x0,55	48,0	47,0	43,0	40,0	35,0	28,0	20,0														
FCD40-VLR2B/60	4x0,75	57,0	56,0	51,0	48,0	42,0	33,0	23,0														
FCD40-VLR2B/70	4x0,75	65,0	65,0	60,0	55,0	49,0	39,0	28,0														
FCD40-VLR2B/90	4x1,1	85,0	84,0	78,0	70,0	62,0	50,0	37,5														
FCD40-VLR2B/110	4x1,1	101,0	100,0	93,0	84,0	74,0	60,0	43,0														
FCD40-VLR2B/130	4x1,5	121,0	120,0	112,0	102,0	89,0	71,0	53,5														
FCD40-VLR4/30	4x0,55	29,0				28,0	26,5	25,0	23,5	22,0	20,5	19,0	16,0	13,0	9,0							
FCD40-VLR4/40	4x0,75	37,0				36,0	34,5	33,0	31,0	29,0	27,0	25,0	21,5	18,0	12,0							
FCD40-VLR4/50	4x1,1	45,0				44,0	43,0	42,0	39,5	37,0	34,0	31,0	27,0	23,0	16,0							
FCD40-VLR4/60	4x1,1	55,0				53,0	51,5	50,0	47,0	44,0	41,0	38,0	31,5	27,0	20,0							
FCD40-VLR4/80-7	4x1,5	64,0				61,0	59,5	58,0	54,5	51,0	47,5	44,0	38,0	32,0	25,0							
FCD40-VLR4/80	4x1,5	75,0				71,0	69,0	67,0	63,0	59,0	54,5	50,0	43,5	37,0	30,0							
FCD40-VLR4/100	4x2,2	91,0				90,0	86,0	82,0	77,0	72,0	66,5	61,0	53,5	46,0	37,0							
FCD40-VLR4/120	4x2,2	109,0				107,0	103,0	99,0	93,0	87,0	80,0	73,0	63,5	54,0	43,5							
FCD40-VLR8/30	4x1,1	33,0					32,0	31,7	31,4	31,0	30,5	30,0	29,5	29,0	28,5	28,0	27,0	25,5	24,0	22,5	21,0	19,0
FCD40-VLR8/40	4x1,5	43,0					42,0	41,6	41,3	41,0	40,5	40,0	39,0	38,0	37,0	36,0	35,0	33,5	32,0	29,5	28,0	26,0
FCD40-VLR8/50	4x2,2	54,0					53,0	52,4	51,7	51,0	50,0	50,0	49,0	48,0	47,0	45,5	44,0	42,0	40,0	37,5	35,0	32,0
FCD40-VLR8/60	4x2,2	65,0					64,0	63,5	63,0	62,0	61,0	60,0	59,0	58,0	56,0	54,0	52,0	50,0	48,0	45,0	42,0	39,0
FCD40-VLR8/80	4x3	86,0					85,0	84,0	83,0	82,0	81,0	80,0	79,0	77,5	75,0	72,5	70,0	67,0	63,5	60,0	56,0	52,0
FCD40-VLR8/100	4x4	108,0					106,0	105,0	104,0	103,0	101,5	100,0	98,0	95,0	92,5	90,5	88,0	84,0	80,0	76,0	69,5	65,0

# FREQUENCY CHANGER

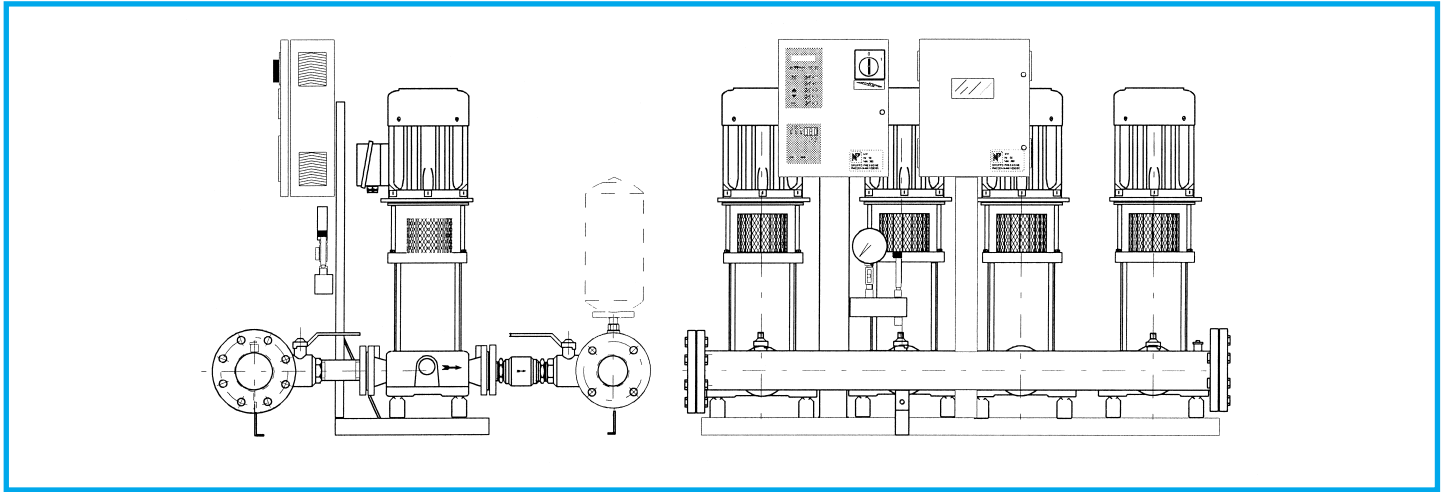

GROUP TYPE	KW	Q = ELECTRIC PUMPS TOTAL CAPACITY																					
		l/min	0	400	600	800	1000	1200	1400	1600	1800	2000	2200	2400	2600	2800	3000	3200	3400	3600	4000	4400	4800
		mc/h	0	24,0	36,0	48,0	60,0	72,0	84,0	96,0	108,0	120,0	132,0	144,0	156,0	168,0	180,0	192,0	204,0	216,0	240,0	264,0	288,0
H = TOTAL PREVALENCE IN METRES OF COLUMNS OF WATER (M.C.A.)																							
FCD40-VLR16/30	4x3	44,0	43,0	41,5	40,0	37,0	32,0	27,0	19,0														
FCD40-VLR16/40	4x4	59,0	58,0	56,0	54,0	52,0	44,0	37,0	23,5														
FCD40-VLR16/50	4x5,5	72,5	72,0	70,0	68,0	65,0	56,0	46,0	29,5														
FCD40-VLR16/60	4x5,5	88,0	87,0	84,0	81,0	78,0	68,0	58,0	41,0														
FCD40-VLR16/70	4x7,5	101,5	101,0	99,0	95,0	90,0	80,0	67,0	45,5														
FCD40-VLR30B/40	4x4	42,0			39,0	38,0	37,0	35,0	32,5	29,5	26,5	23,0	19,0										
FCD40-VLR30B/30	4x5,5	63,0			58,0	57,0	55,0	53,0	48,0	44,0	40,0	34,0	29,0										
FCD40-VLR30B/40	4x7,5	83,0			78,0	77,0	74,0	70,0	65,0	58,0	53,0	45,0	38,0										
FCY40-VLR30B/50	4x11	104,0			97,5	96,0	92,0	88,0	81,0	73,5	66,0	57,0	48,0										
FCD40-VLR60B/20	4x5,5	37,0							33,0	32,5	32,0	31,0	30,0	29,0	27,5	26,0	25,0	23,5	22,0	19,0	15,0	12,0	
FCD40-VLR60B/30	4x7,5	55,0							51,0	49,5	48,0	46,5	45,0	44,0	42,5	40,0	38,0	35,0	33,0	28,0	22,0	17,0	
FCY40-VLR60B/40	4x11	74,0							67,0	65,0	63,0	61,5	60,0	57,5	55,0	53,0	51,0	48,0	44,0	38,0	28,0	23,0	
FCY40-VLR60B/50	4x15	93,0							84,0	82,0	80,0	77,5	75,0	72,0	69,0	66,0	63,0	60,0	56,0	48,0	36,0	28,0	
FCY40-VLR60B/60	4x15	111,0							102,0	99,0	96,0	93,0	90,0	86,5	83,0	79,5	76,0	71,0	66,5	58,0	43,0	35,0	